


[STABILIZED (SEE SPECIAL NOTES).]

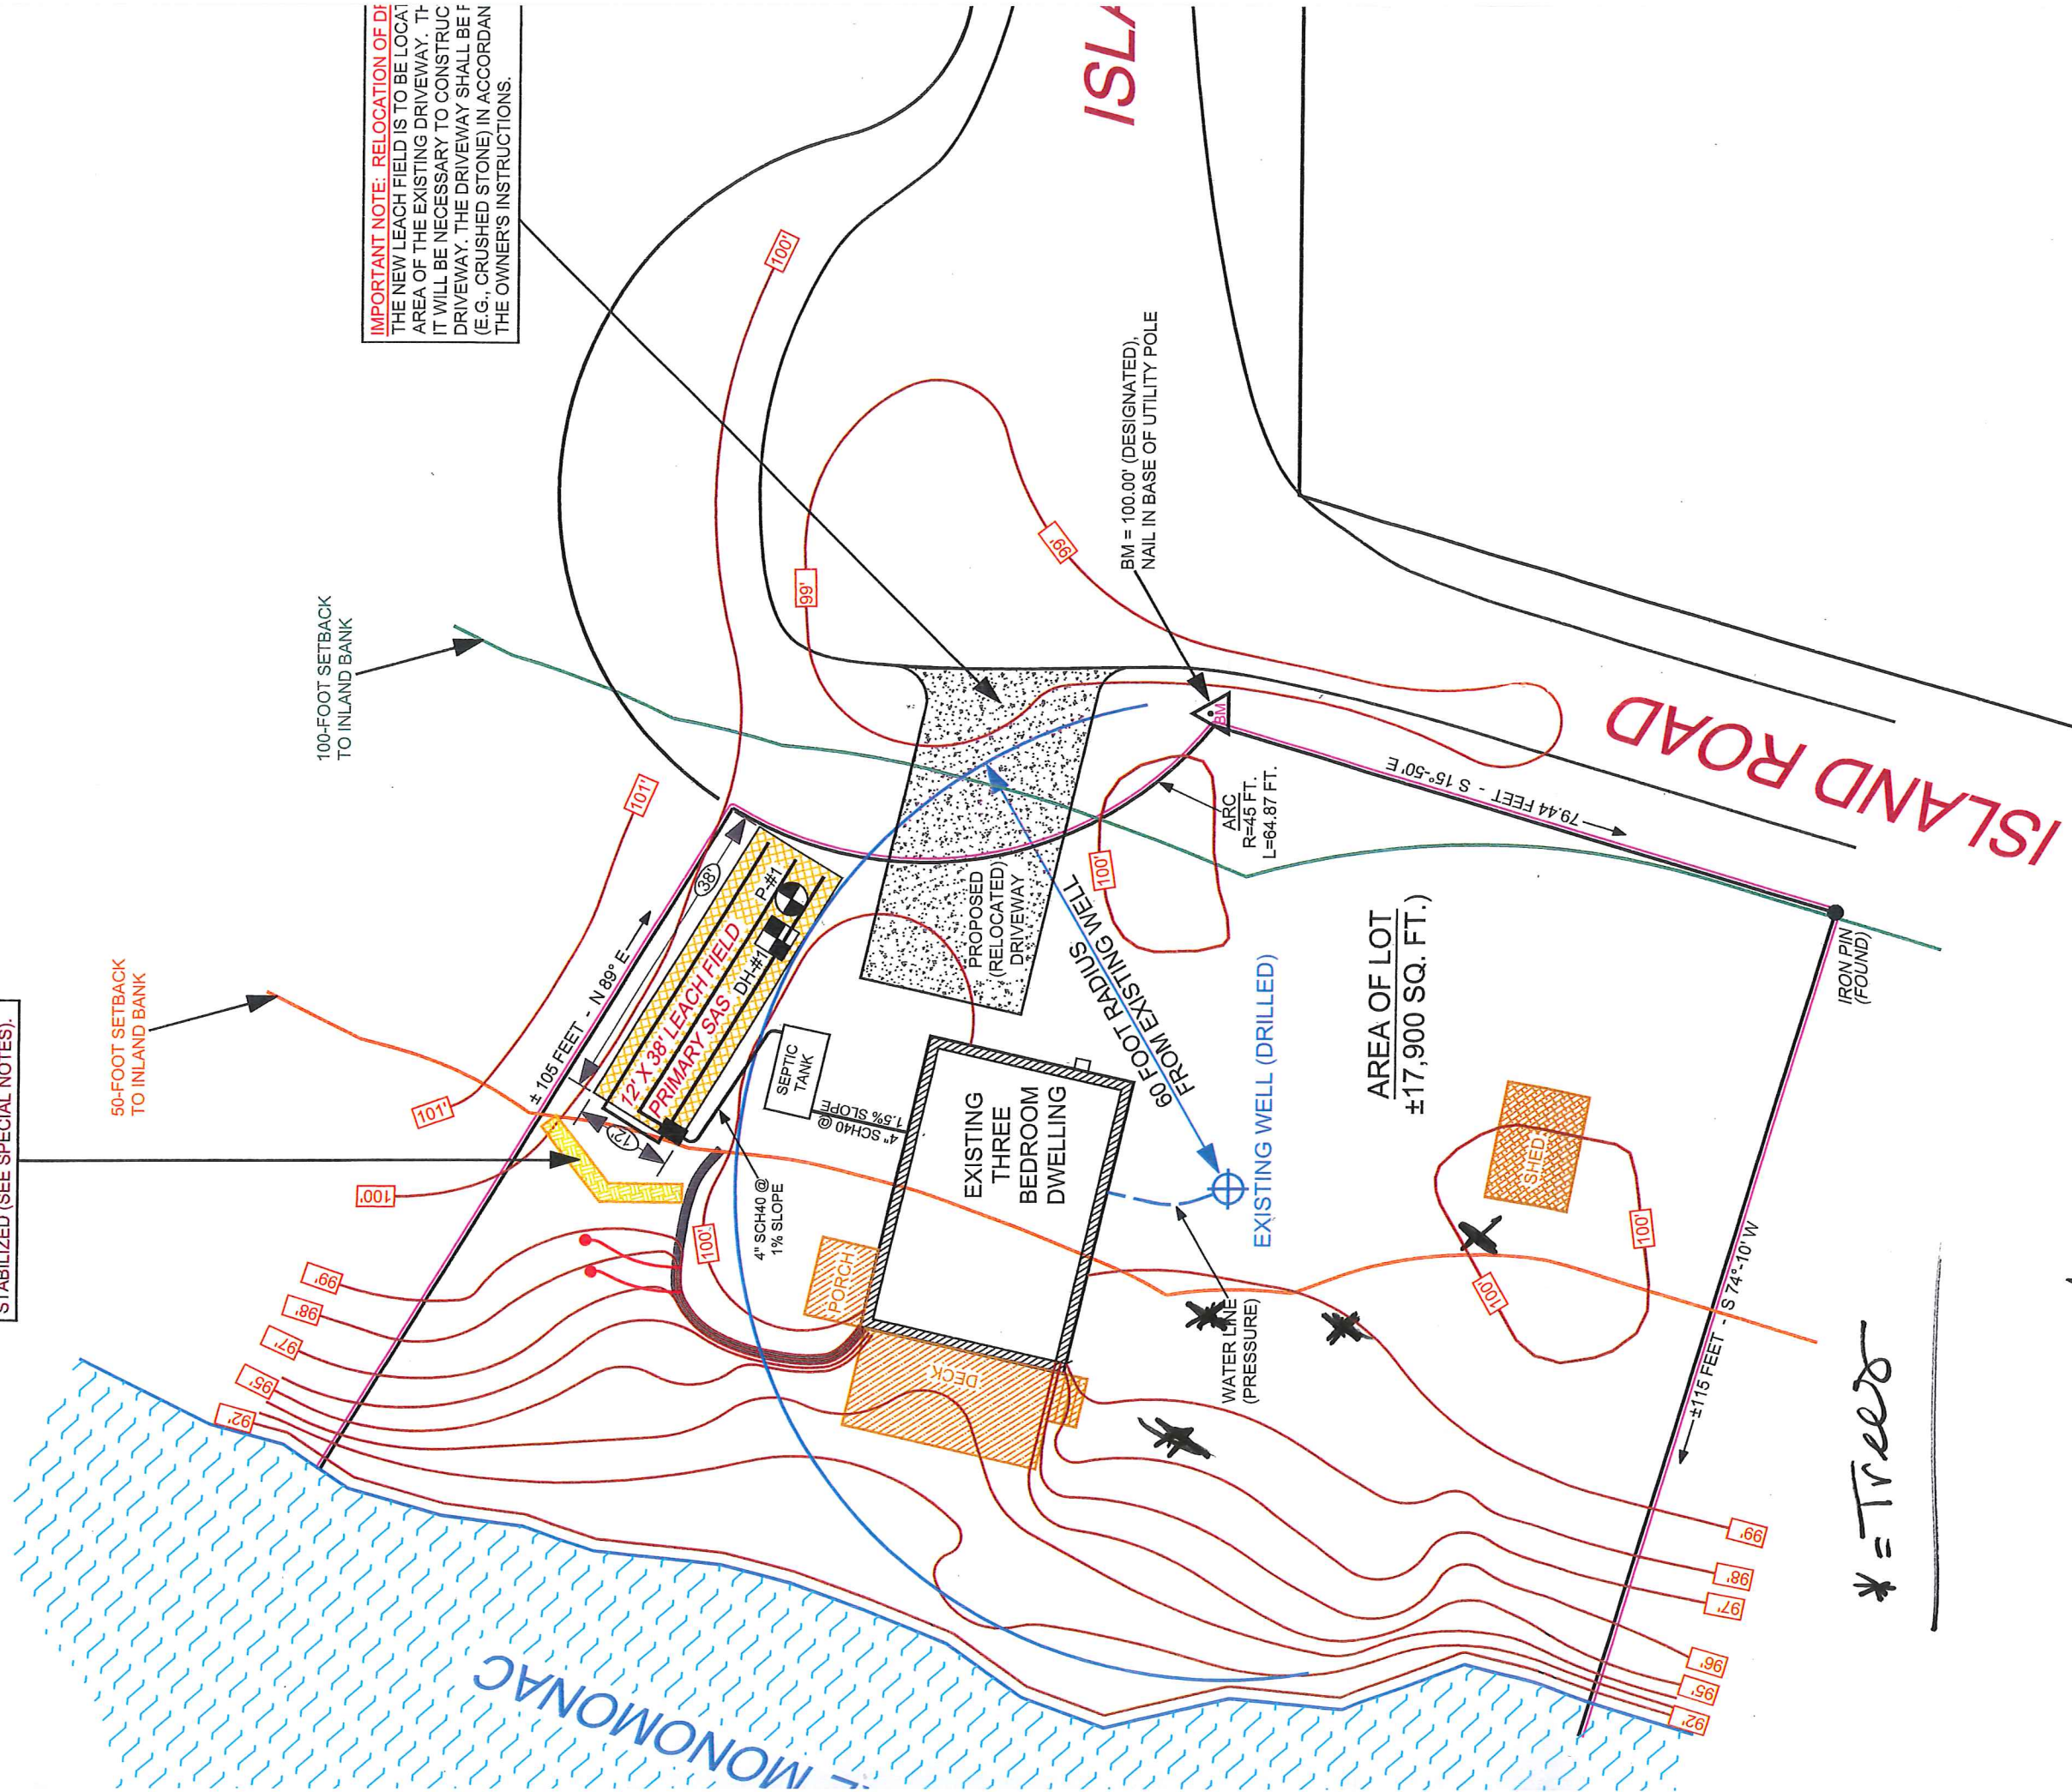

IMPORTANT NOTE: RELOCATION OF THE NEW LEACH FIELD IS TO BE LOCATED IN THE AREA OF THE EXISTING DRIVEWAY. IF IT WILL BE NECESSARY TO CONSTRUCT A DRIVEWAY, THE DRIVEWAY SHALL BE FURNISHED WITH (E.G., CRUSHED STONE) IN ACCORDANCE WITH THE OWNER'S INSTRUCTIONS.

* = Trees

195 Island
Ladlow

NOTE: Tank shaft cover riser shall be 6 inches of final grade.

BEDDING OF SEPTIC TANK AND D-BOX
The bedding of the septic tank and d-box shall consist of a minimum of 6" of 3/4" crushed stone below their bases. Upon excavating to the correct elevation for the septic tank and d-box, the soils shall be compacted prior to the placement of the crushed stone.

EXIST. SILL ELEV. = ±101.00'

